

Product: 9p23 Power Supply
Purpose: Concern on RC23 power supply ferrites and AC power cable.
Date: 6/4/2004

RC23 Power Supply Installation/Repair Instruction Part # 641300

General

The charging rack and the modular power supply combined make a modular charging station. Each charging rack module charges four cordless phones or batteries simultaneously, and each modular power supply module can supply three charging racks.

Concerns

1. Some power supply modules returned for repair do not have the original AC cable required for warranty service.
2. Ferrites are not installed properly.

Solution

1. The power supply comes with the required original AC cable and must not be modified. If the customer chooses to modify the cable, then the customer must use a different AC power cable.
2. If the ferrites are not installed in the unit, the customer must install the ferrites as shown in illustration 1.

- Note:**
1. Before working with the unit, the main power supply cable must be disconnected.
 2. Use cable ties to secure the ferrites to the plastic housing. See Illustration 1.

Technical Service Bulletin

ascom
Ascom® Wireless Solutions Inc.

Product: 9p23 Power Supply
Purpose: Concern on RC23 power supply ferrites and AC power cable.
Date: 6/4/2004

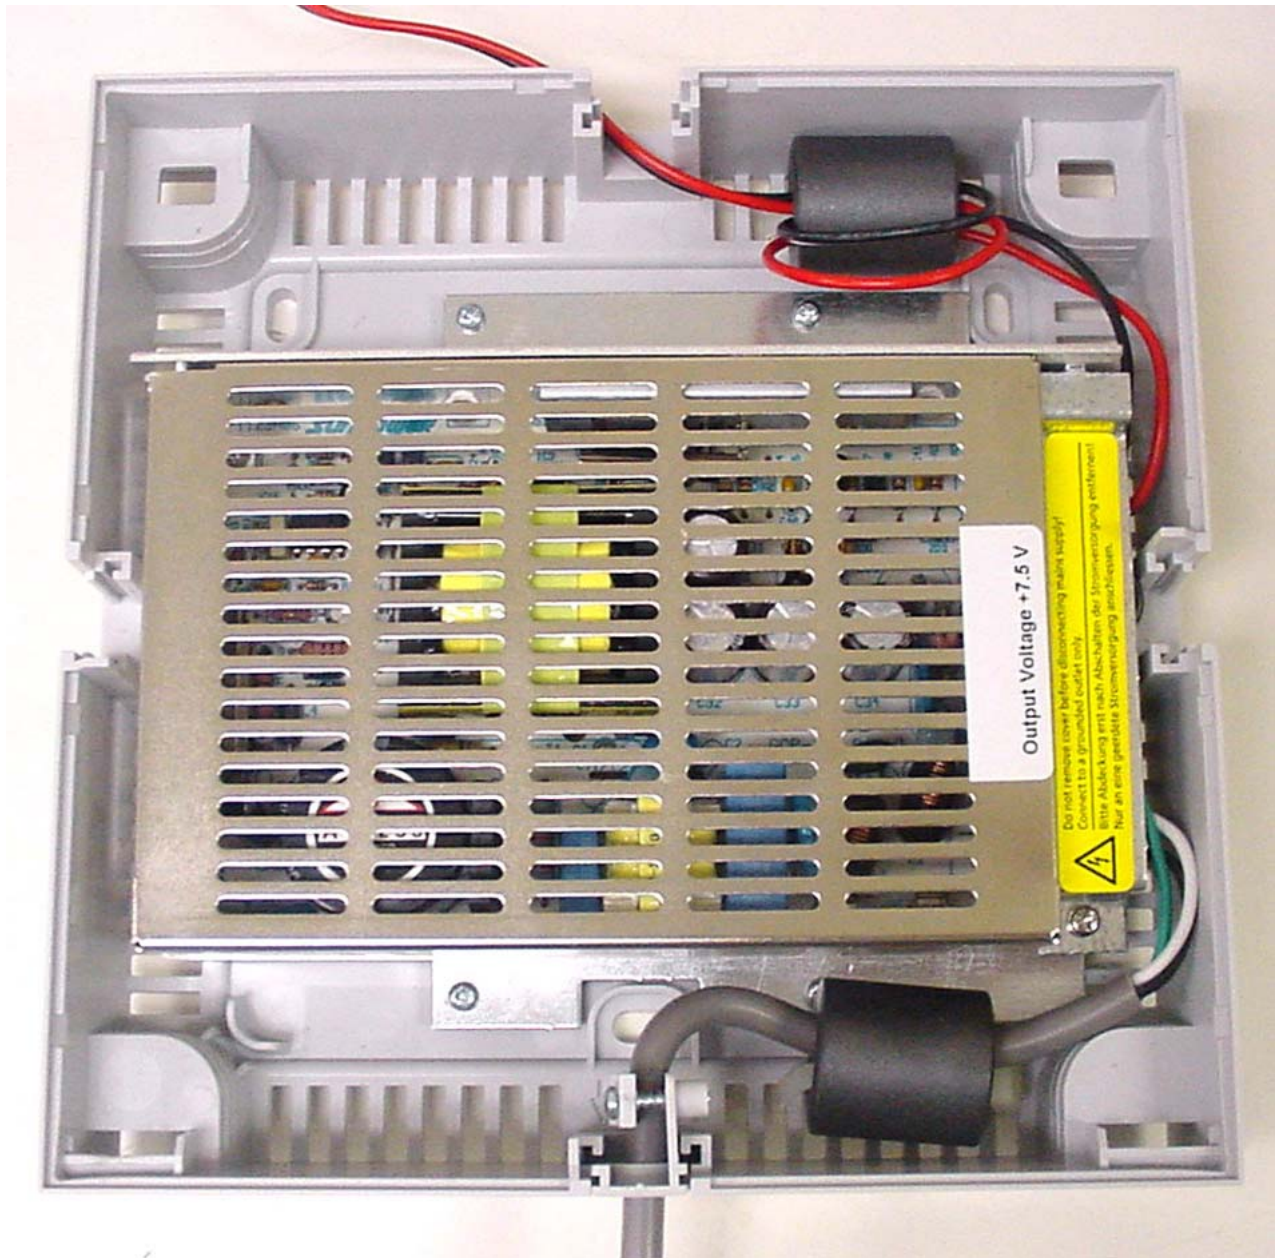


Illustration 1